

Product Specification

Type : GL-B310E-EC-05

Blauberg	Compilation	Check	Approved
	Knight		Ryan
Customer	Proofread	Check	Approved

[illegible]


Norminal Data

Type	GL-B310E-EC-05
Motor	EC102AC230V750W-35
Phase	1 ~
Nominal Voltage	230VAC
Nominal Voltage Range	184 ~ 276VAC
Frequency	50/60 Hz
Method of Obtaining Data	FA
Nominal Speed	2960±5%RPM
Max. Input Power	700W
Max. Input Current	3.1A
Sound level	85dB(A)
Min. Ambient Temperature	-25°C
Max. Ambient Temperature	60°C

ML=Max. load ME=Max. efficiency FA=Free Air

Technical description	
Weight	14.3Kg
Packaging	12PCS/Pallet
Fan size (L×W×H)	440×440×276.5mm
Motor Size	102
Impeller Material	Aluminum Alloy
Number of Blades	8
Direction of Air Flow	All Around
Direction of Rotation	Clockwise, Viewed Toward Rotor
Rotor Surface	Plastic Spraying (Blue)
Rotor Housing	Stretch
Degree of Protection	IP55
Insulation Class	Class F
Min. Permitted Ambient Temp. for Motor (Transport/Storage)	-40°C
Max. Permitted Ambient Temp. for Motor (Transport/Storage)	+80°C
Min./Max. Humidity	5% ~ 90%RH
Min./Max. Storage	5% ~ 95%RH
Installation Position	Any
Cooling Holes/Cut-outs	None
Mode	S1
Motor Bearing	Ball Bearing
Technical Features	◆Output 10 VDC, Max. 10 mA ◆Control Input 0-10 VDC / PWM,PWM Max. Input Voltage 10VDC ◆PFC Power Correction ◆RS485 MODBUS-RTU ◆Locked Rotor Protection ◆Thermal Protection ◆Excessive Voltage Protection ◆Less Voltage Protection ◆Overcurrent Protection ◆Soft Start
Strength Class of Screws	8.8
Length of Cable	500±20mm
Dielectric Strength	1800VAC/50Hz, 1s, Leakage Current ≤10mA, No Breakdown Flashover
Touch Current According to IEC 60990	≤3.5mA
Conformity with Standards	CCC、CE、RoHS Plug fan model GL-B310E-EC-05 use BL-B310E-EC-05 centrifugal fan model, which meets the requirements of CE certification.

Air Performance

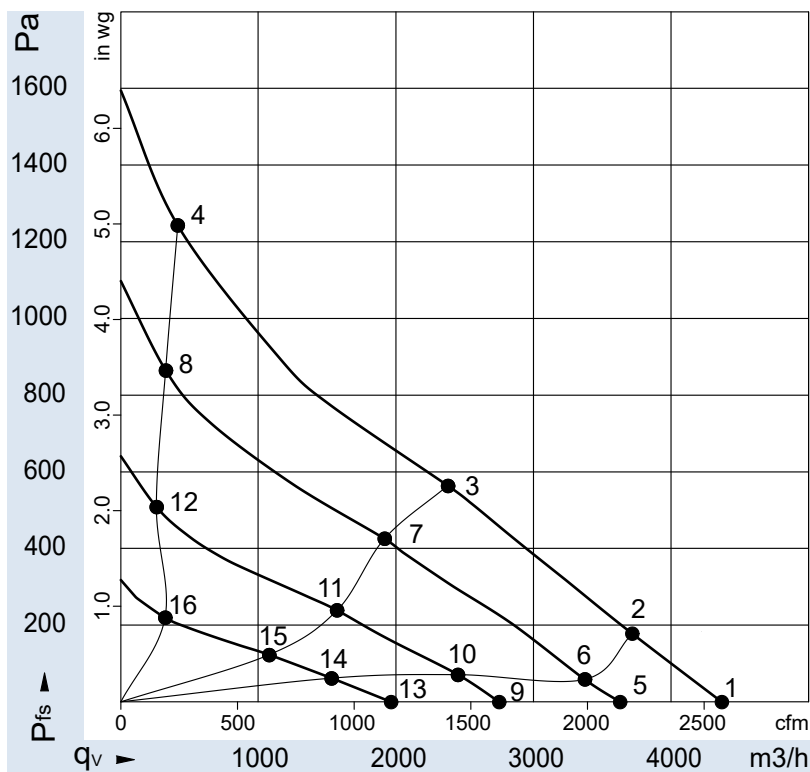


Air performance measured according to AMCA210/GB1236 installation category A. For detailed information on the measurement setup, contact Blauberg. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

Testing Data

	U	f	N	P _{ed}	I	q _v	q _v	P _{fs}	P _{fs}
	V	Hz	rpm	W	A	m³/h	cfm	Pa	in wg
1	230	50	2720	707	3.14	4367	2570	0	0
2	230	50	2557	682	3.02	3717	2188	178	0.715
3	230	50	2392	679	3.01	2377	1399	564	2.267
4	230	50	3070	414	3.14	414	244	1243	4.996
5	230	50	2285	409	1.81	3627	2135	0	0
6	230	50	2257	408	1.81	3371	1984	59	0.237
7	230	50	2023	409	1.81	1917	1129	426	1.712
8	230	50	2572	409	1.81	327	192	865	3.477
9	230	50	1780	187	0.85	2749	1618	0	0
10	230	50	1690	187	0.85	2450	1442	71	0.285
11	230	50	1550	187	0.85	1571	925	239	0.961
12	230	50	1937	187	0.85	259	152	509	2.045
13	230	50	1283	73	0.37	1964	1156	0	0
14	230	50	1152	73	0.37	1532	902	62	0.248
15	230	50	1103	73	0.37	1078	635	123	0.496
16	230	50	1292	73	0.37	322	190	220	0.884


U=Power Supply f=Frequency n=Speed P_{ed}=Power Consumption I=Current Draw q_v=Air Flow
P_{fs}=Pressure Increase

Outline Drawing

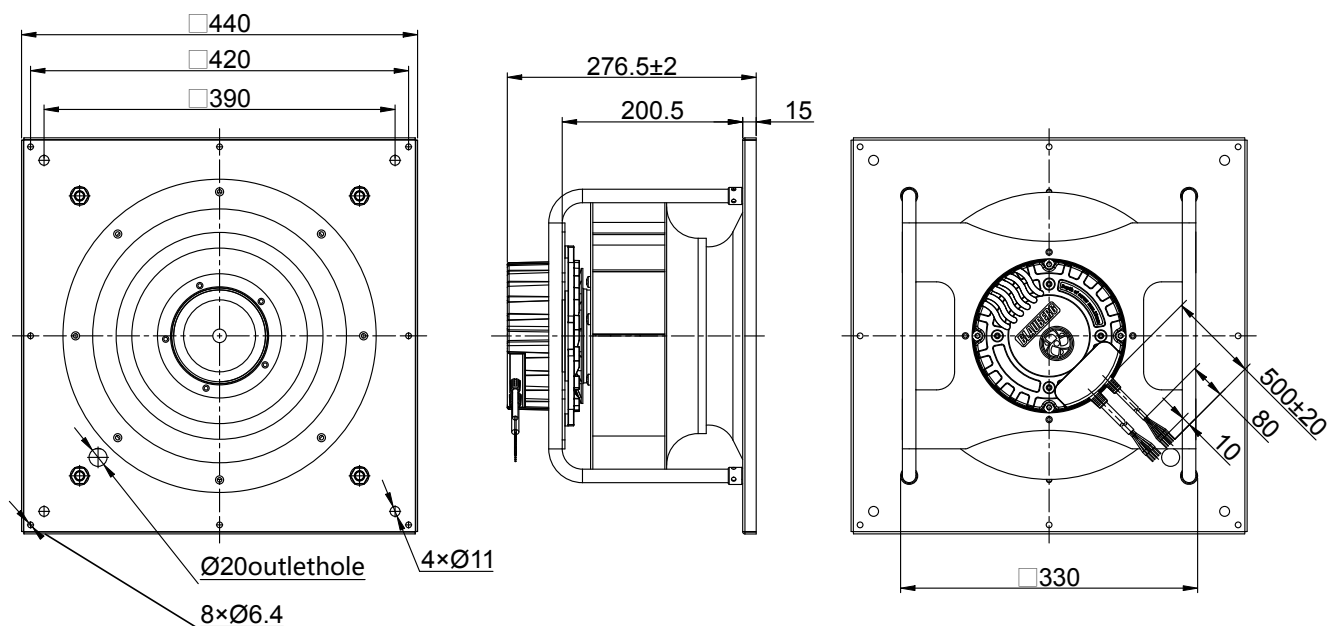

- | | |
|---|----------------------|
| 1 | AC Cable PVC 5×AWG18 |
| 2 | DC Cable PVC 6×AWG22 |


Wiring Diagram

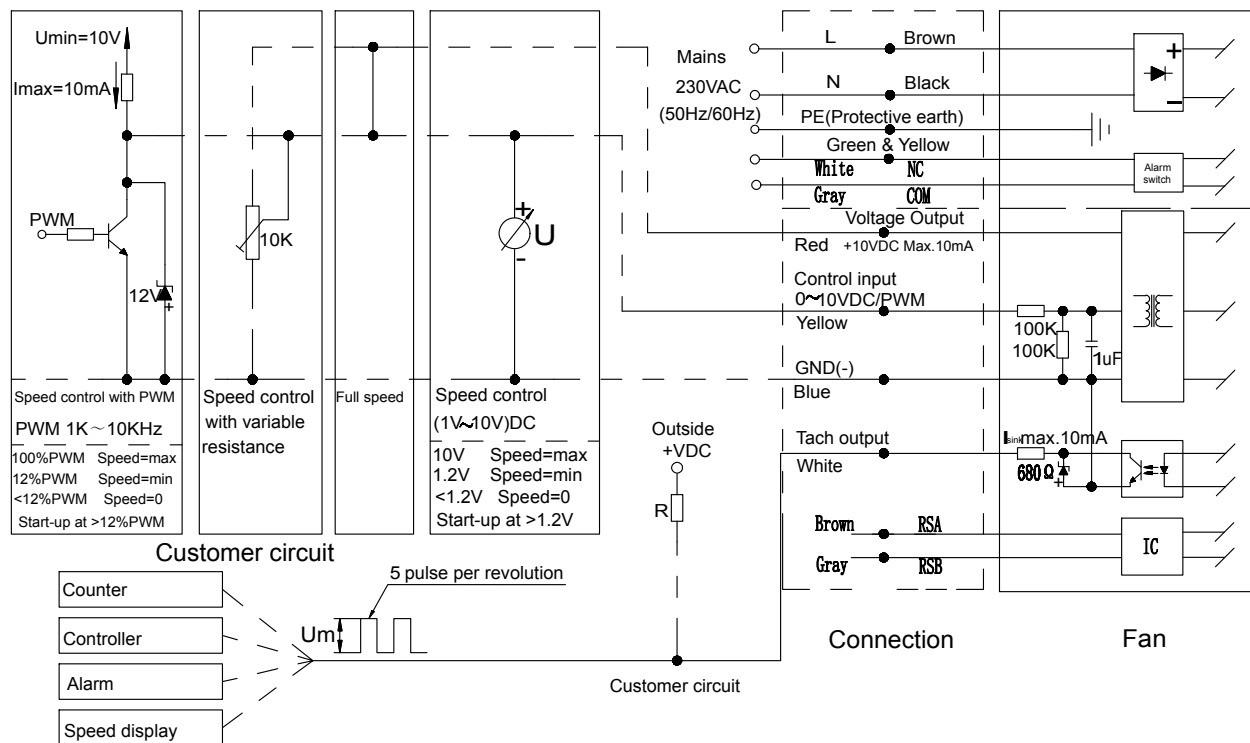

Line	Conn.	Designation	Colour	Function/Assignment
Power Line		PE	Green/Yellow	Protective Earth
	U1	L	Brown	Power supply, live wire see nameplate for voltage range
	U2	N	Black	Power supply, neutral wire see nameplate for voltage range
	U3	NC	White	Status relay, point A, Normally close, break for failure, contact rating 250VAC/2A
	U4	COM	Gray	Status relay, Point B, common connection, contact rating 250VAC/2A, isolated from power and control interfaces
Control Line	U5	RSA	Brown	RS485 interface for MODBUS, RSA;SELV
	U6	RSB	Gray	RS485 interface for MODBUS, RSB;SELV
	U7	Speed Control	Yellow	0-10V/PWM(Max. amplitude of PWM 10V) control input;SELV
	U8	Signal Feedback	White	Tach output, 5 pulse per revolution, (pulses can be customized, or changed to RD signal);SELV
	U9	+10V	Red	Fixed voltage output 10 VDC $\pm 5\%$, Imax.10mA, power supply for external devices(e.g.potentiometers);SELV
	U10	GND	Blue	Reference ground for control interface;SELV

Speed Setting


1.Full Speed

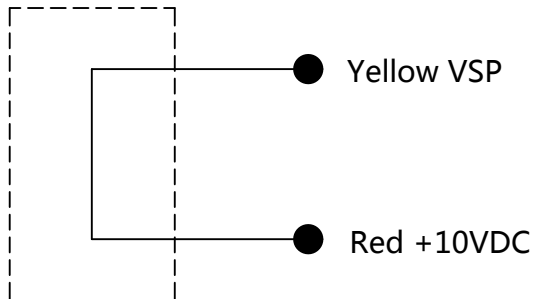

Short Red&Yellow

Fan will run full speed

2.Voltage Control 0-10VDC($\pm 0.2V$)

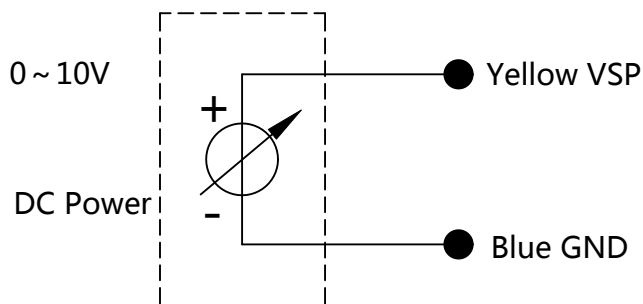


User DC power support 0 ~ 10VDC voltage

Voltage higher than 1.0V DC,fan start up

Voltage lower than 0.5V DC,fan stop

$\geq 1.0VDC$ Fan start up

3.PWM Control,PWM duty 0%-100%($\pm 2\%$)

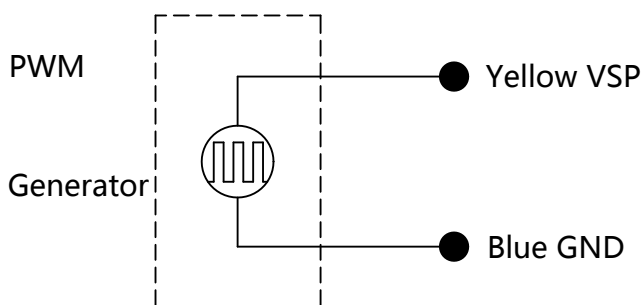

PWM duty control

PWM suggest amplitude:10VDC($\pm 5\%$)


PWM Frequency:1KHz ~ 10KHz

PWM duty higher then 10%,fan start up

PWM duty lower then 5%,fan stop

$\geq 10\%$ PWM duty,fan start up

4.Potentiometer Control

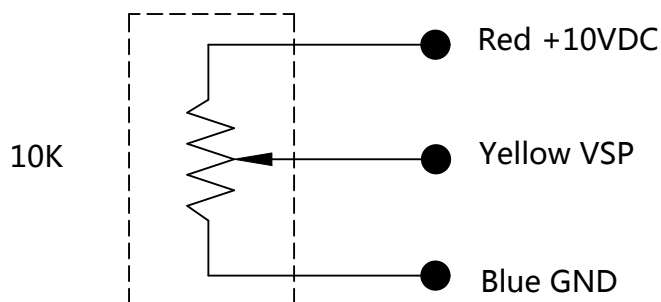

Suggest to use 10K potentiometer


Voltage higher than 1.0V DC,fan start up

Voltage lower than 0.5V DC,fan stop


$\geq 1.0VDC$ Fan start up

Potentiometer


Wiring Label

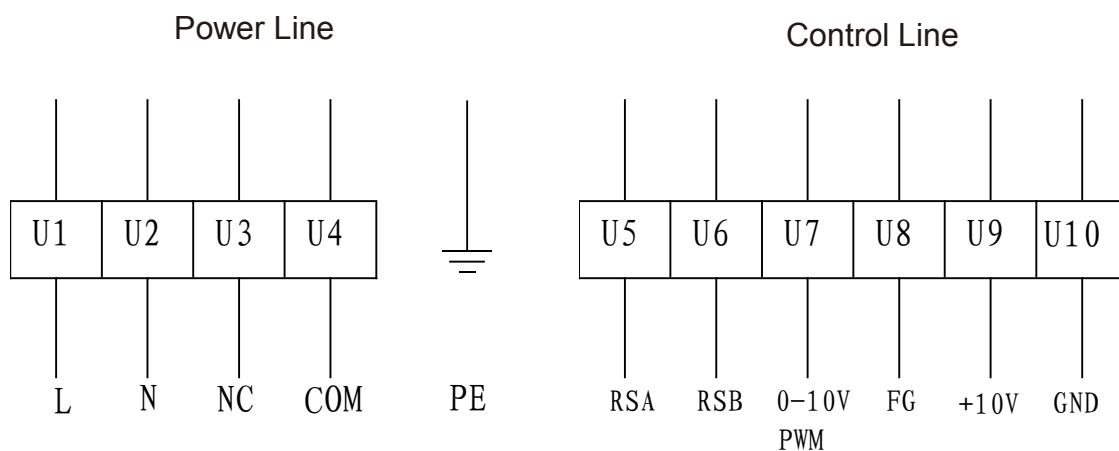

Wiring diagram for signal feedback

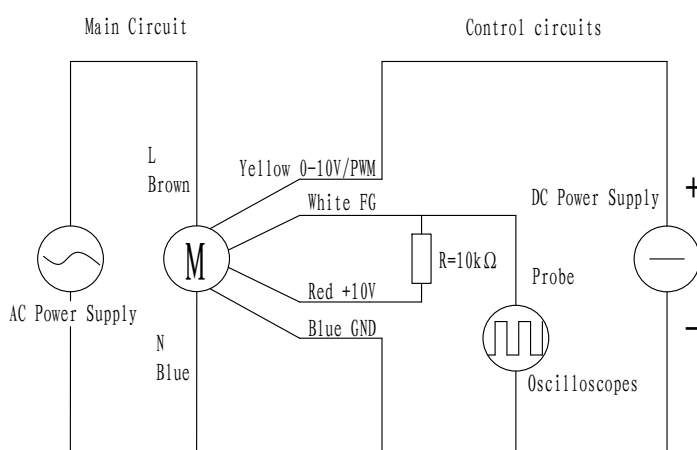

The fan provides a speed output signal, output signal drawing see under annex.
Vfg and pull up resistor are connected by customer.
 $V_{fg} = (3.3 - 30) \text{ VDC}, R \geq 1000 \times (v_{fg}) \Omega$

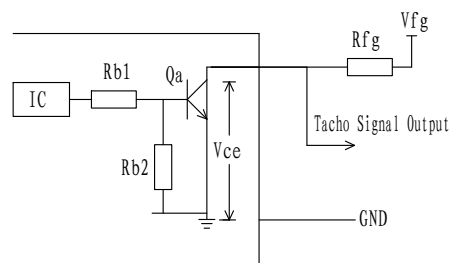

Speed Calculation

$$n = 60f/a ;$$

n = Fan speed

a = Pulse (Several Pulse/Revolutions)

f = Signal Output waveform frequency

Note

1	The power line and control line of the fan should be connected in strict accordance with the wiring diagram to prevent the fan from burning out;
2	Do not connect the white signal wire directly to the red signal wire or the external DC power supply;
3	If the fan does not work after starting, please check the input voltage of the speed regulation, which may be improperly connected. To prevent hand or other personal injury caused by sudden start of the fan; Do not touch the impeller or rotor after electrifying;
4	It takes a few seconds for the fan to start after power on. In order to prevent personal injury, do not touch the impeller or rotor under the condition of electrifying or low speed operating;
5	Before turning on the power, please check whether the motor is installed reliably, otherwise it will cause the motor to burn and personal accidents;
6	It is forbidden to pull the power cord too hard, If the power cord is damaged, the power cord must be replaced by the manufacturer to avoid electric shock accidents;
7	It is forbidden to drop or crash the motor;
8	It is strictly forbidden to flush the motor to prevent leakage accidents caused by reducing the insulation performance of the motor and endangering personal safety;
9	If you need to use special customized products for purposes other than the agreed working conditions, please consult our company first and confirm to use;
10	After the fan operation stops, the temperature of the motor casing may be high in a short period of time, please avoid direct release. Protect if necessary Measures to prevent burns;
11	When installing the equipment, pay attention to check the casing and other shells, no debris can fall in, and clean up the inside if necessary;
12	Before the equipment is installed and running, the rotor should be pulled by hand to confirm that there is no collision, interference or jamming before it can be powered on;
13	As a part of the fan, the motor cannot be used alone without impeller or load;
14	After the product packaging has been disassembled, it should be repackaged if it needs to be kept in storage. The product shall be stored in a clean, well-ventilated warehouse with ambient temperature of -40°C~+80°C, relative humidity of no more than 95%, no corrosive gases in the air, and 15cm above the ground. ;
15	Please install the fan out of the reach of children and do not allow children to use this product;
16	The final interpretation right of this specification belongs to Blauberg.

Life and maintenance, warranty

1	The design life of the fan is 50,000h, which is limited by the life of the ball bearing at 40°C of 50,000h. The actual service life of the fan will vary depending on the temperature, humidity, installation method, fan load and other conditions of the use environment;
2	According to the environment, it is recommended to clean and maintain the fan every 3~6 months;
3	From the date of purchase (subject to the delivery date of the order), the warranty period of the whole machine is two years, during this period, the company provides free replacement or repair for the failure and damage caused by the quality problem of the product itself. If the damage is caused by undue disassembly, handling, man-made damage or natural disasters and other force majeure, it is not covered by the Blauberg's warranty.